

### ClaytonGO: Foundation Plan Summary

Order Number: **N/A**  
 Model Number: **941-VIS16783A**  
 Home Building Facility: **941**

Home Width: **15 FT 0 IN**  
 Home Length: **78 FT 0 IN**  
 Outrigger Length (O.R.): **40.25 IN**  
 Chassis Spacing: **99.5 IN**

Roof Load: **20 PSF**  
 Soil Bearing Cap: **1500 PSF**  
 Min. I-Beam Size: **8 IN**  
 Calculated Eave/Overhang: **6 IN**

Use this QR Code to access DAPIA approved tables referenced within this design. Hover your iPhone camera over the code. For Android and other devices, download a QR Code reader.  
**Questions? Email [sitecompletionq&a@claytonhomes.com](mailto:sitecompletionq&a@claytonhomes.com)**

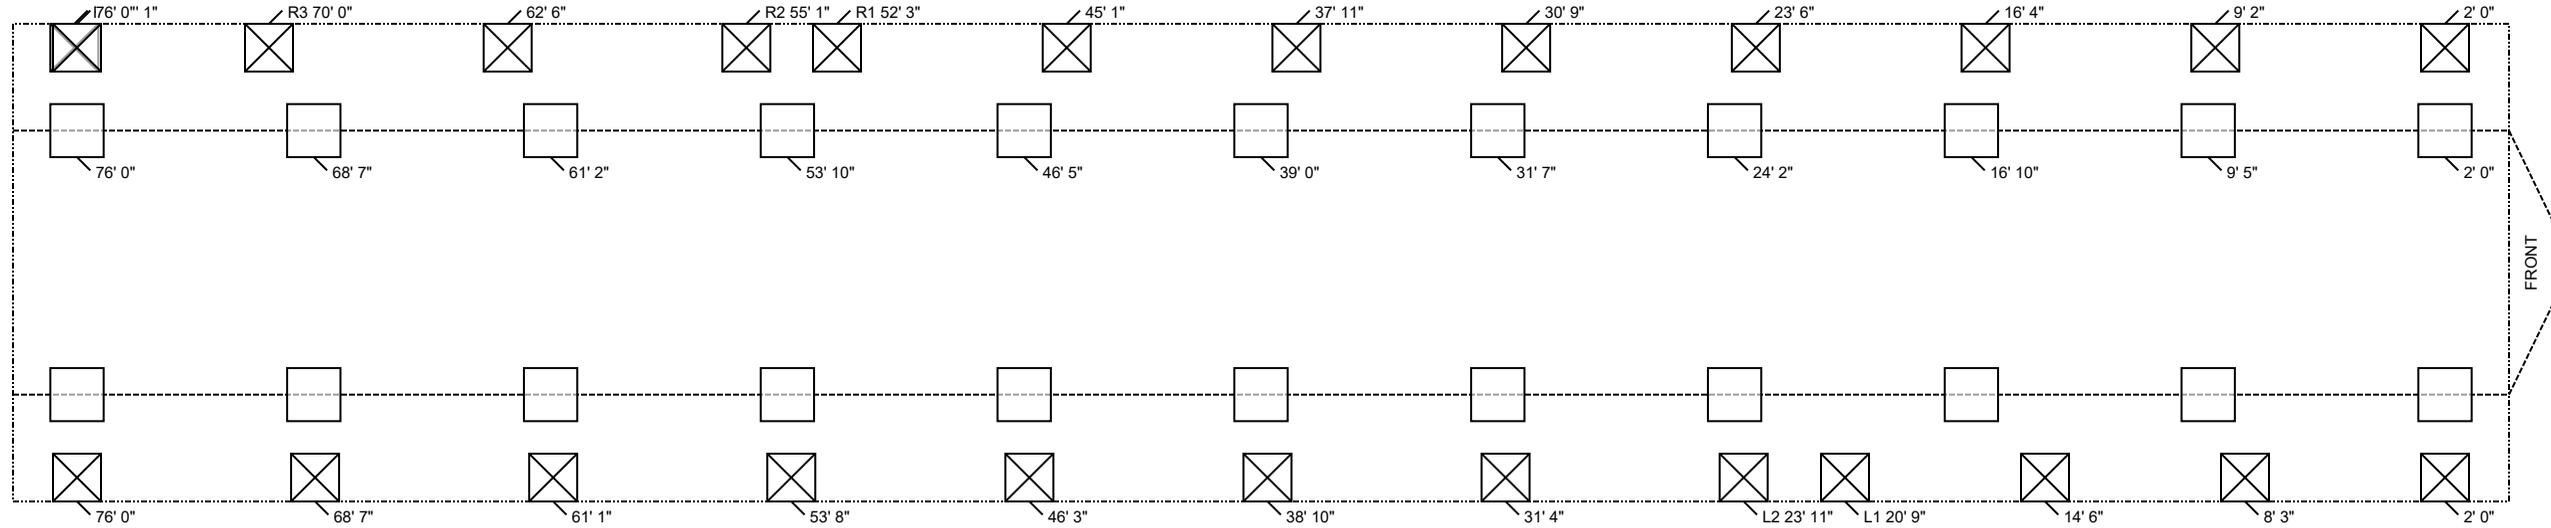


TABLE 1: FRAME PIERS		
Pier Spacing	Pier Configuration	Footer Size
TYP. 7 FT 5 IN	Single stacked	20 IN x 20 IN x 6 IN
MAX. 8 FT 0 IN	Single stacked	20 IN x 20 IN x 6 IN

(Table 7a)

TABLE 2: EXTERIOR PIERS		
Pier ID	Pier Configuration	Footer Size
L1, L2	Single stacked	18 IN x 18 IN x 6 IN
R1, R2, R3, R4	Single stacked	18 IN x 18 IN x 6 IN

(Table 7a)



**NOTES:**



- FROST PROTECTION WILL BE PROVIDED BY PLACING FOOTERS BELOW FROST DEPTH OF 36 INCHES PER (FIGURE 5A) OR FROM LAHJ. Frost depth for interior footers may be taken as half with R5 skirting per (Table 4a) [3285.312(b)]
- SIDEWALL PIERS SHALL BE PLACED AT EXTERIOR DOORS AND WINDOW OPENINGS GREATER THAN 48" PER TABLE 2.
- ALL FOOTERS WILL BE POURED CONCRETE. ALL SINGLE STACKED PIERS WILL HAVE A MINIMUM FOOTER THICKNESS OF 6 INCHES with footer depth extending below frost depth using 3,000 PSI minimum concrete (table 10A) (table 8)
- THIS PIER LAYOUT HAS BEEN DERIVED USING PE SEALED & DAPIA APPROVED INSTALLATION MANUAL AS OUTLINED ABOVE. PLEASE SEE INSTALLATION MANUAL FOR PE SEAL AND DAPIA APPROVAL. (Reference to Clayton Homes DAPIA approved Installation manual) [Reference to Federal Statutes 24 CFR Part 3280, 3285 or 3286]



02/28/2023  
1:37PM

CARBON MONOXIDE (CO) ALARMS ARE ONLY REQUIRED WHEN ONE OR MORE OF THE FOLLOWING ARE PROVIDED BY THE HOME BUILDING FACILITY (HBF):

1. THE HOME IS EQUIPPED WITH A FUEL BURNING APPLIANCE INSTALLED AT THE HBF.
2. THE HOME HAS BEEN DESIGNED FROM THE HBF FOR AN ATTACHED GARAGE ADDITION.
3. THE HOME HAS BEEN DESIGNED FROM THE HBF WITH A BASEMENT ACCESS THROUGH THE FLOOR.

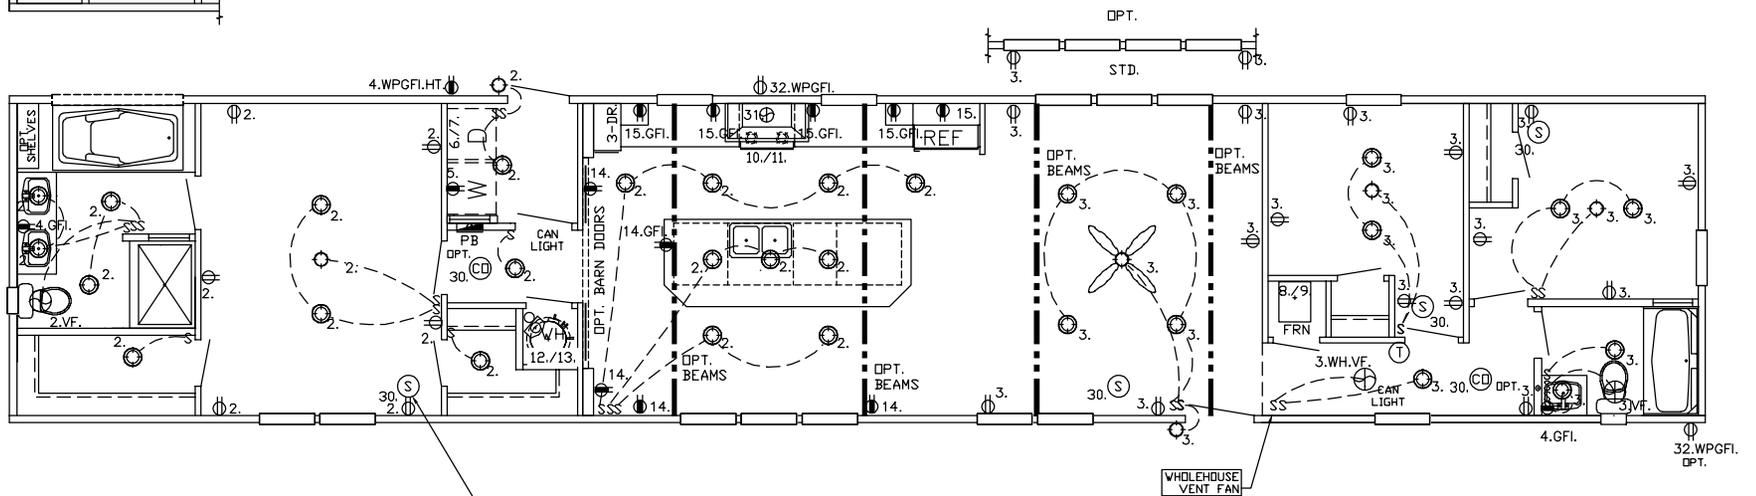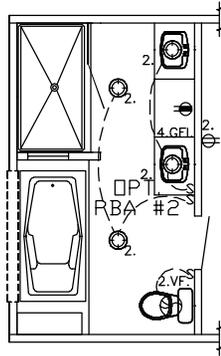

REQUIRED TO BE SMOKE/CARBON MONOXIDE ALARM COMBO UNIT WHEN A GAS WATER HEATER IS OPTIONED IN

MP-16.VIS16783A.2

REF. EL-24 FOR NOTES & CIRCUITS  
REF. PLN-11 FOR GENERAL NOTES  
● = RECEP. = 20AMP CIRCUIT = 12-2 WIRE


D:\ACADSG\UPDATED-MODELS-03-26-2021\VIS16783A.dwg

**SOUTHERN HOMES**  
MODEL VIS16783A-78-3/16X78

02/28/2023


1:37PM

# DRAIN LINES

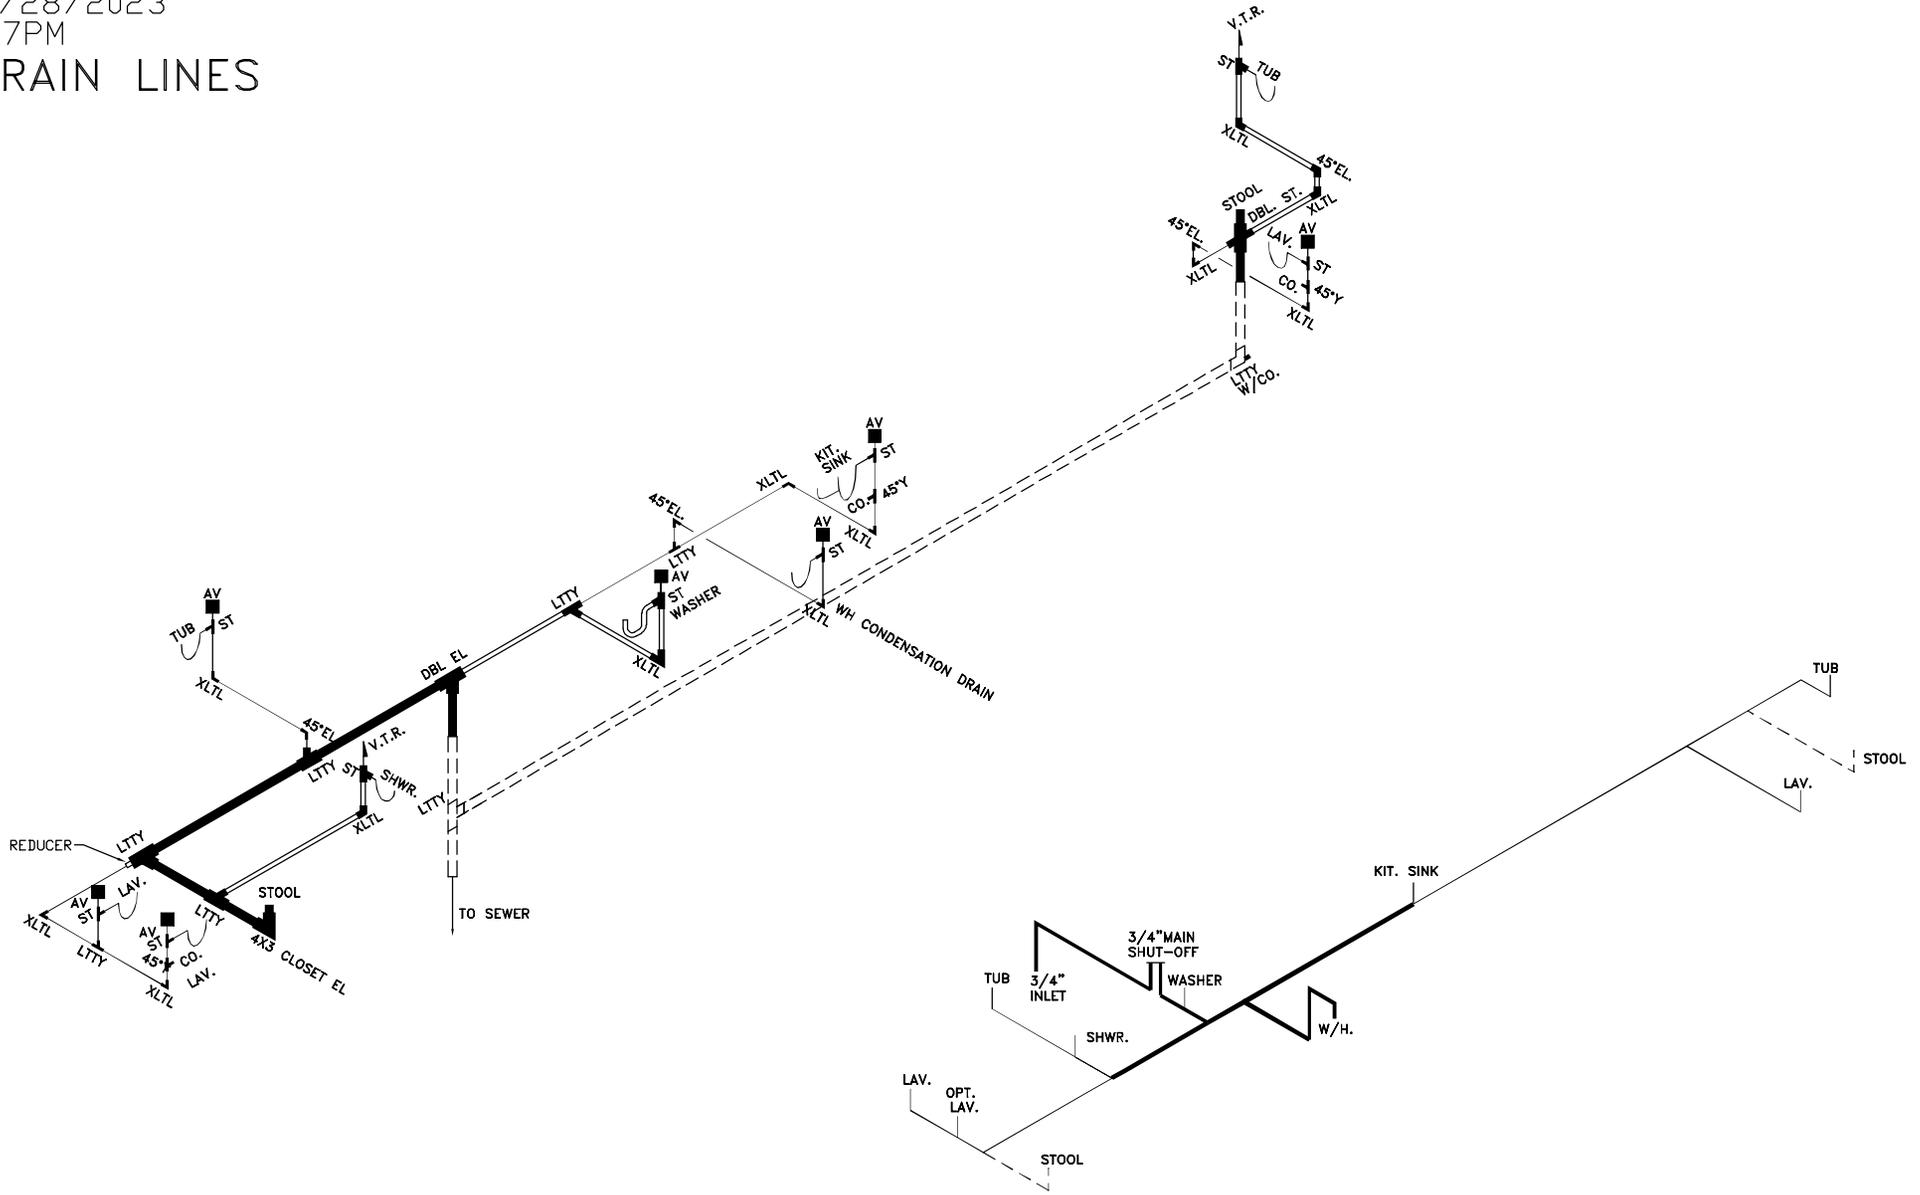

MP-16.VIS16783A.3

# WATER LINES

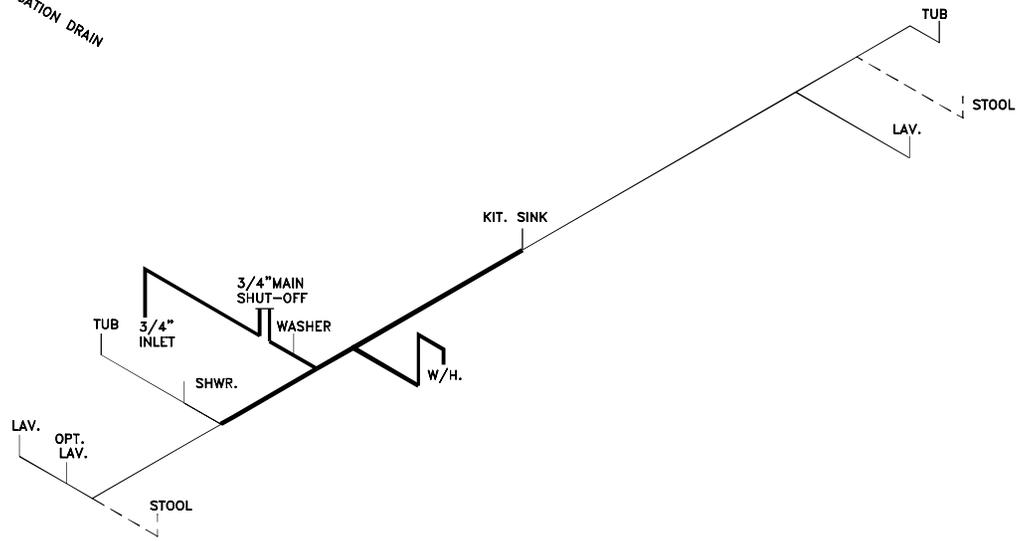

LOOSE PLUMBING FOR FIELD INSTALL	SIZE	3'	3'	3'	3'	3'	3-15	3x3x2	3'	3-2	2'	2'	2'	2'	2'	2-15	1 1/2	1 1/2	1 1/2	1 1/2	CLEAN	CD.
ITEM	LTTY	XLTL	COUP	DBL.EL.	ST	REDUC	LTTY	PIPE	REDUC	LTTY	XLTL	COUP	PIPE	ST	REDUC	LTTY	XLTL	COUP	PIPE	OUT	PLUG	
QTY.	2		2			1		80'													1	1
$\text{---} \text{---} \text{---} \text{---} \text{---}$ = 1 1/2" $\text{---} \text{---} \text{---}$ = 2" $\text{---} \text{---} \text{---}$ = 3"	FOR DRAIN LINES																					
$\text{---} \text{---} \text{---} \text{---} \text{---}$ = 1 1/2" $\text{---} \text{---} \text{---}$ = 2" $\text{---} \text{---} \text{---}$ = 3"	FOR ON-SITE DRAIN LINES																					
$\text{---} \text{---} \text{---}$ = 1/2" $\text{---} \text{---} \text{---}$ = 3/4" $\text{---} \text{---} \text{---}$ = COLD ONLY	FOR WATER LINES																					
DRAIN, & WATER PIPING TYP. NOTE: DWGS. NOT TO SCALE TYP. NOTE FOR DRAIN LINES: STOOL TRAP ARM LESS THAN 6'-0" DASHED LINES ARE FIELD INSTALLED											TYP. NOTES: REFER TO PLN-11 FOR GEN. NOTES SEE DAPIA FOR ANY DETAILS NOT SHOWN ON DRAWINGS.											
TYP. NOTE FOR WATER LINES: COLD AS SHOWN, FOR HOT LINES DELETE STOOL INLET & SHUTOFF																						

D:\ACADSG\UPDATED-MODELS-03-26-2021\VIS16783A.dwg

## STANDARD LAYOUT


10.167' MDL 3/4  
 56.25' MDL 1/2  
 0.71 VOL (GAL)

**SOUTHERN HOMES**  
 MODEL VIS16783A-78-3/16X78

02/28/2023

1:37PM

# DRAIN LINES

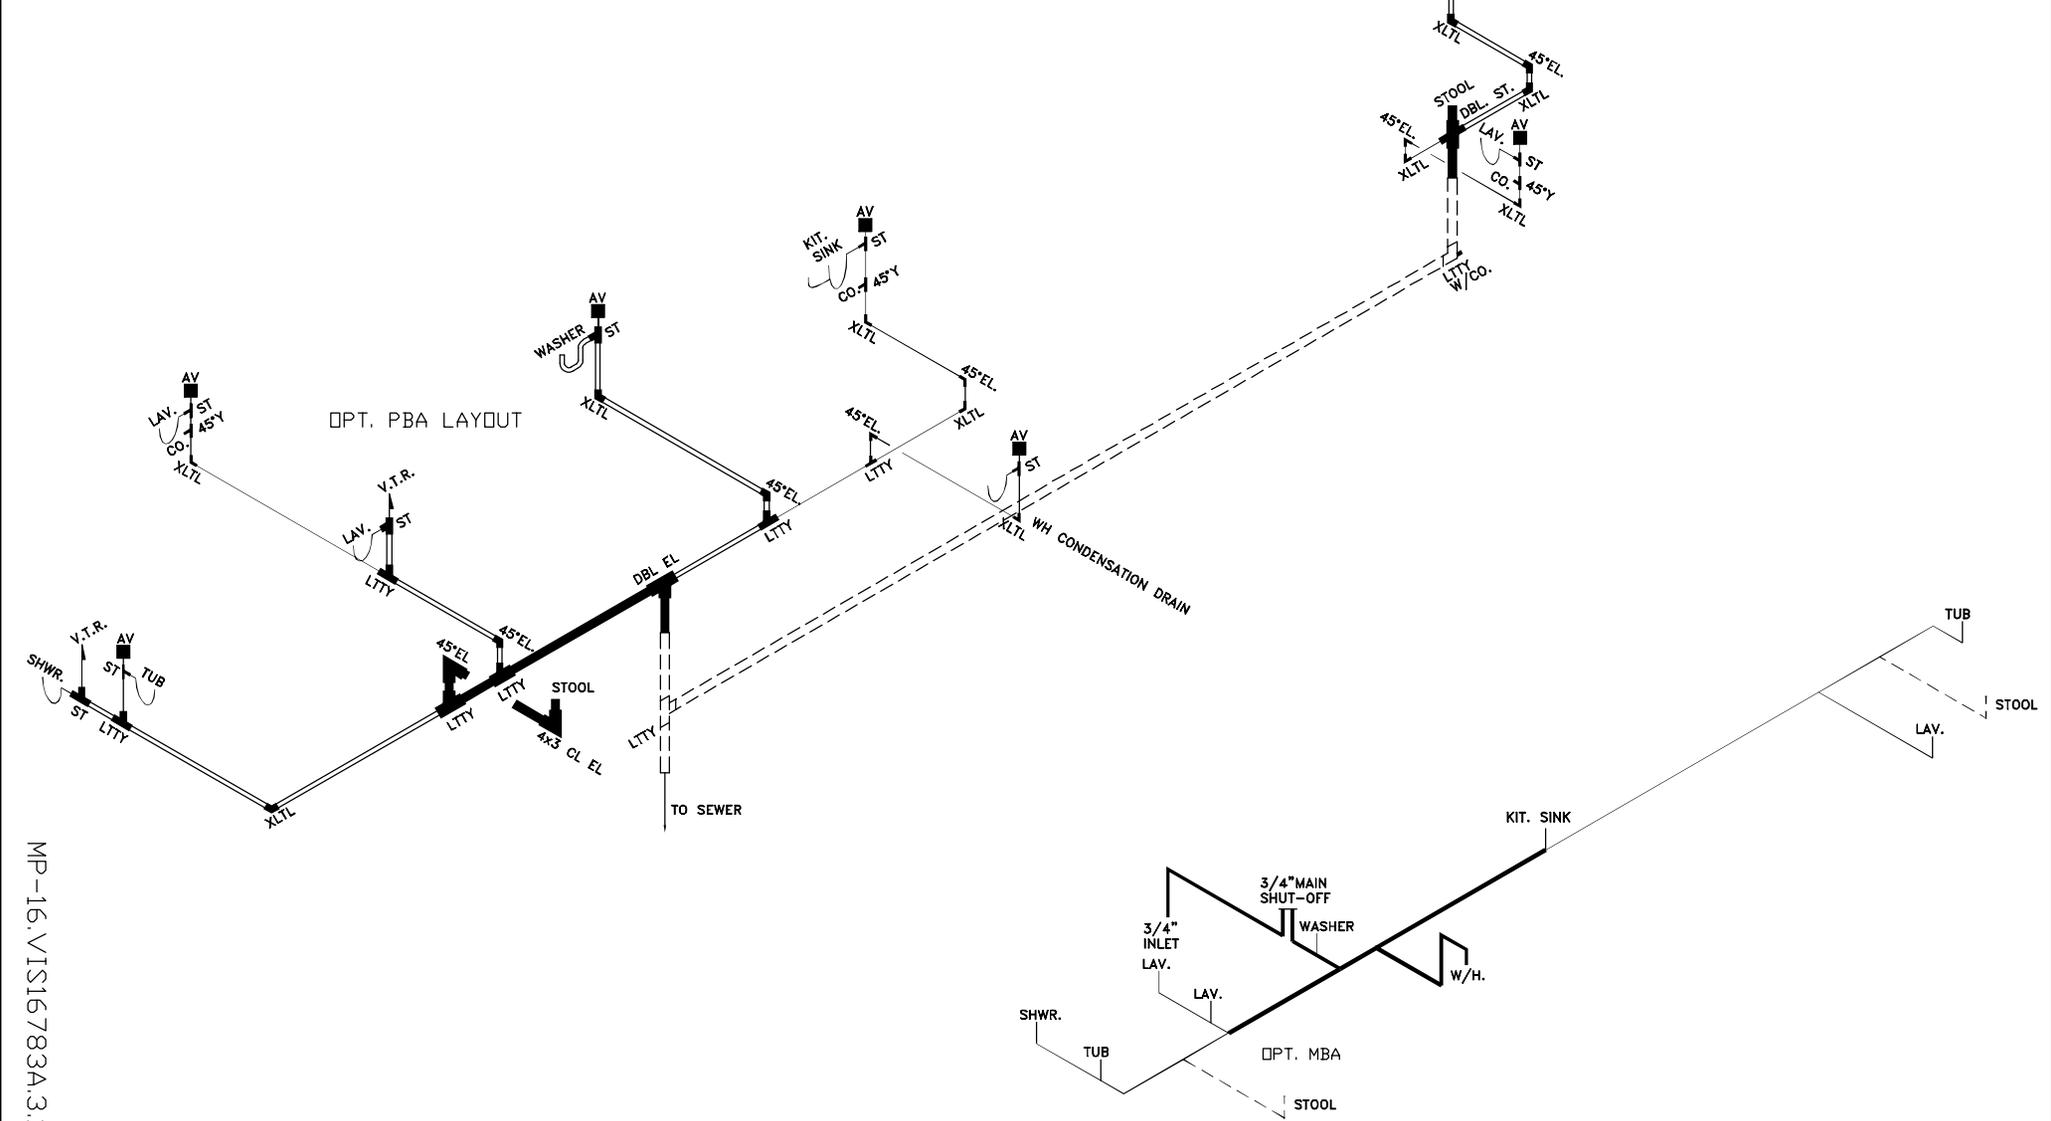

MP-16.VIS16783A.3.1

# WATER LINES

LOOSE PLUMBING FOR FIELD INSTALL	SIZE	3'	3'	3'	3'	3'	3-15	3x3x2	3'	3-2	2'	2'	2'	2'	2'	2-15	1 1/2"	1 1/2"	1 1/2"	1 1/2"	CLEAN	CD.
ITEM	LTTY	XLTL	COUP	DBL.EL	ST	REDUC	LTTY	PIPE	REDUC	LTTY	XLTL	COUP	PIPE	ST	REDUC	LTTY	XLTL	COUP	PIPE	OUT	PLUG	
QTY.	2		2			1		80'													1	1
$\text{---} \text{---} \text{---} = 1 \frac{1}{2}" \#$	$\text{---} \text{---} \text{---} = 2" \#$	$\text{---} \text{---} \text{---} = 3" \#$	FOR DRAIN LINES			DRAIN. & WATER PIPING TYP. NOTE: DWGS. NOT TO SCALE																
$\text{---} \text{---} \text{---} = 1 \frac{1}{2}" \#$	$\text{---} \text{---} \text{---} = 2" \#$	$\text{---} \text{---} \text{---} = 3" \#$	FOR ON-SITE DRAIN LINES			TYP. NOTE FOR DRAIN LINES: STOOL TRAP ARM LESS THAN 6'-0" DASHED LINES ARE FIELD INSTALLED																
$\text{---} \text{---} \text{---} = 1/2" \#$	$\text{---} \text{---} \text{---} = 3/4" \#$	$\text{---} \text{---} \text{---} = \text{COLD ONLY}$	FOR WATER LINES			TYP. NOTE FOR WATER LINES: COLD AS SHOWN, FOR HOT LINES DELETE STOOL INLET & SHUTOFF																

OPT. PBA

10.167' MDL 3/4  
56.25' MDL 1/2  
0.71 VOL (GAL)

D:\ACADSG\UPDATED-MODELS-03-26-2021\VIS16783A.dwg

## SOUTHERN HOMES

### MODEL VIS16783A-78-3/16X78